

# 611


## Dial Before You Dig

You May Be  
Digging Into  
Underground  
Telephone Cable  
Or Conduit



# Buried Service Specifications

1. To protect your buried services, it is highly recommended that a raceway be provided by a contractor/property owner.
  - A. Schedule 40 PVC conduit, not to exceed 300 ft., is to be used. If greater than 300 ft., contact DTC Engineering Department to determine if additional requirements are needed.
  - B. Conduit at residential locations must be two inches outside diameter or greater.
  - C. Conduit at business locations must be two inches outside diameter or greater.
  - D. Conduit may contain no more than three 24" sweep L's (90 degrees).
  - E. Each conduit must have a high quality nylon pull rope.
  - F. Buried conduit must be two feet below finished ground level.
  - G. Conduit termination must be located within three to five feet of the power service entrance for grounding purposes and three to five feet above ground level.

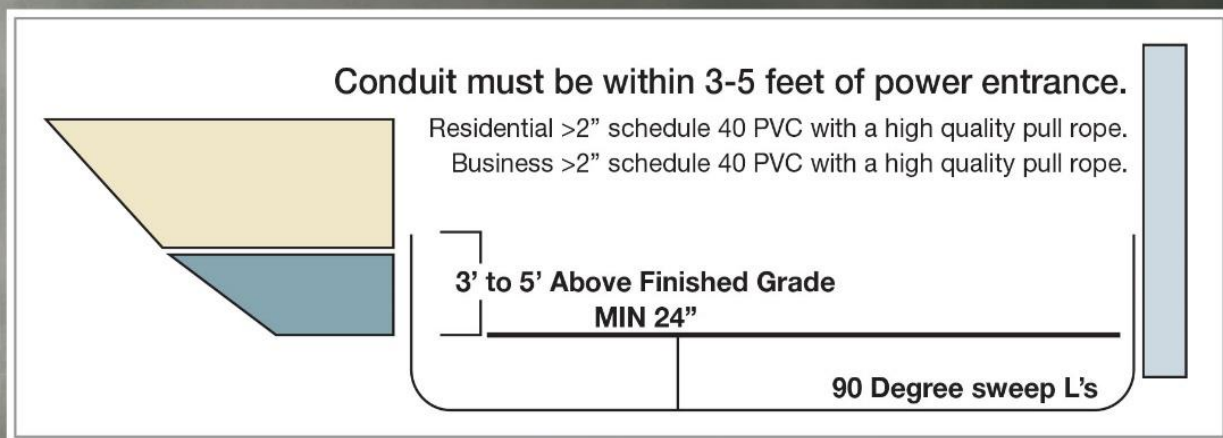

**All Exchanges**  
(from your home or business phone)

**Dial 611**